




Enviro-Aire

CAPITAL SEPTIC SUPPLY



IM-1530

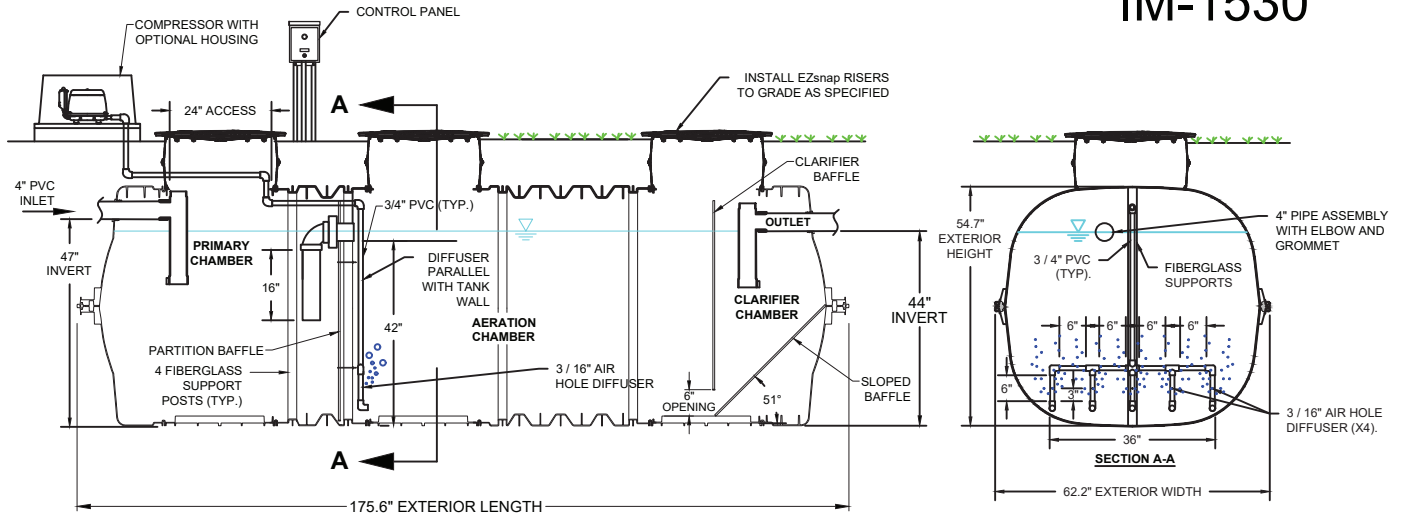


| TREATMENT PLANT | TREATMENT CAPACITY (GPD) | TOTAL VOLUME (GAL) | AERATION VOLUME (GAL) | CLARIFIER VOLUME (GAL) | PRIMARY VOLUME (GAL) | BOD LOADING (LBS/DAY) | CFM |
|-----------------|--------------------------|--------------------|-----------------------|------------------------|----------------------|-----------------------|-----|
| EA75 IM1530 | 750 | 1586 | 780 | 276 | 530 | 1.875 | 4.5 |

**NOTE: 1. ADD 1% VOLUME FOR BAFFLES
2. ADD 1% VOLUME FOR DELTA BTW ACTUAL AND THEORETICAL VOLUME (DUE TO SAG)**

NOTES:

1. INSTALL ENVIRO-AIRE AREOBIC TREATMENT UNIT PER INSTALLATION INSTRUCTIONS.
2. INSTALL TANK PER INSTALLATION INSTRUCTIONS.
3. AIR COMPRESSOR INSTALLED WITHIN 100 FT OF THE TANK.

IM-1060

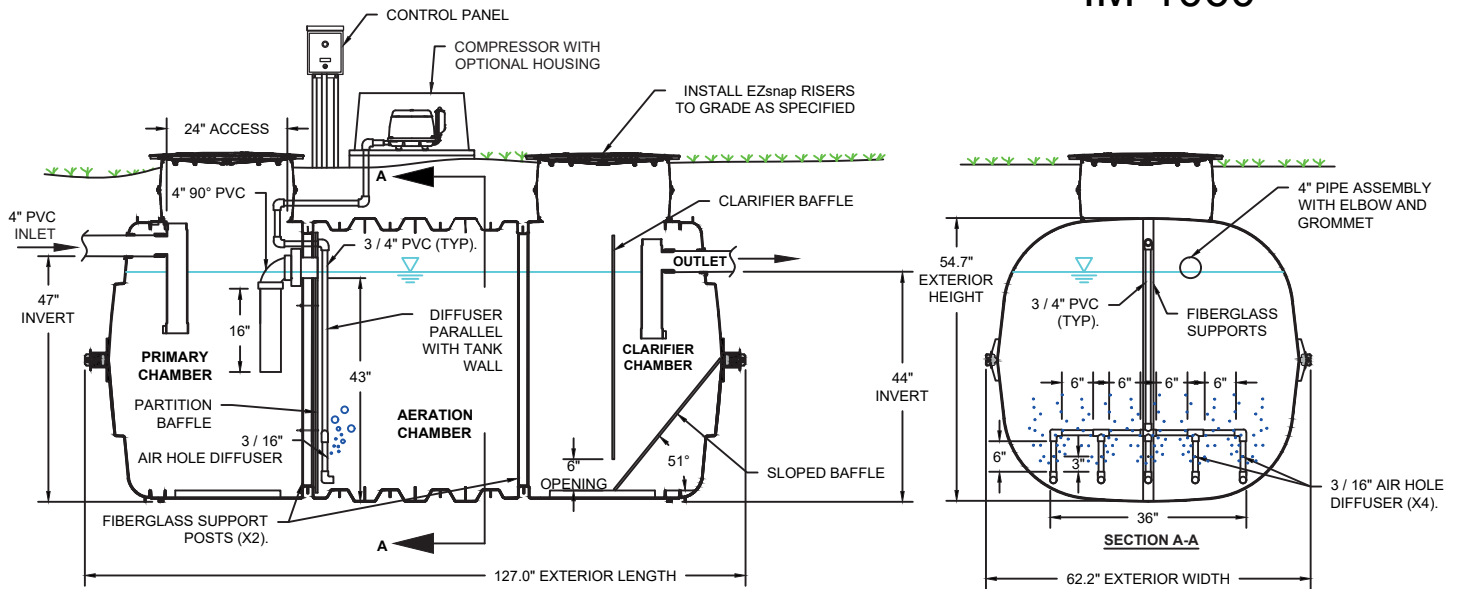

| TREATMENT PLANT | TREATMENT CAPACITY (GPD) | TOTAL VOLUME (GAL) | AERATION VOLUME (GAL) | CLARIFIER VOLUME (GAL) | PRIMARY VOLUME (GAL) | BOD LOADING (LBS/DAY) | CFM |
|-------------------|--------------------------|--------------------|-----------------------|------------------------|----------------------|-----------------------|-----|
| EA 52.5 IM1060 | 525 | 1122 | 558 | 181 | 383 | 1.31 | 2.6 |

NOTES:

1. INSTALL ENVIRO-AIRE AREOBIC TREATMENT UNIT PER INSTALLATION INSTRUCTIONS.
2. INSTALL TANK PER INSTALLATION INSTRUCTIONS.
3. AIR COMPRESSOR INSTALLED WITHIN 100 FT OF THE TANK.
4. FLORIDA CATEGORY 4 BRACING INCLUDES TWO (2) HORIZONTAL STIFFENERS AND FOUR (4) DIAGONAL STIFFENERS.
5. DIAGONAL AND HORIZONTAL STIFFENERS NOT SHOWN.



CAPITAL SEPTIC SUPPLY

